
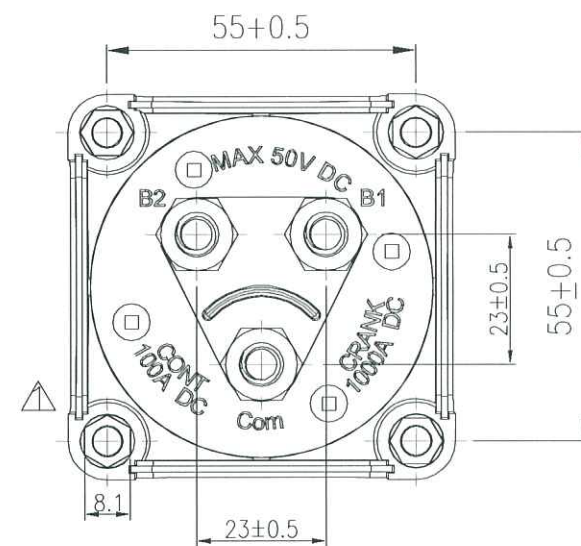
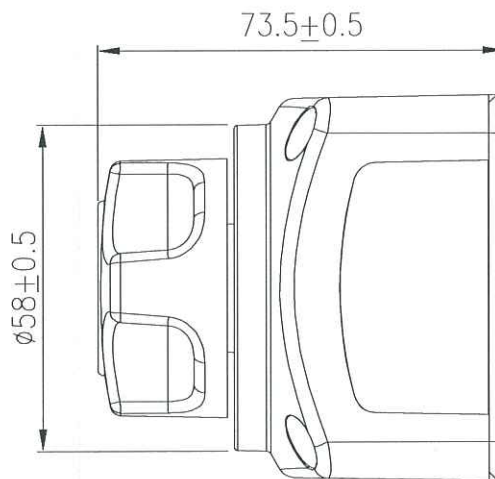


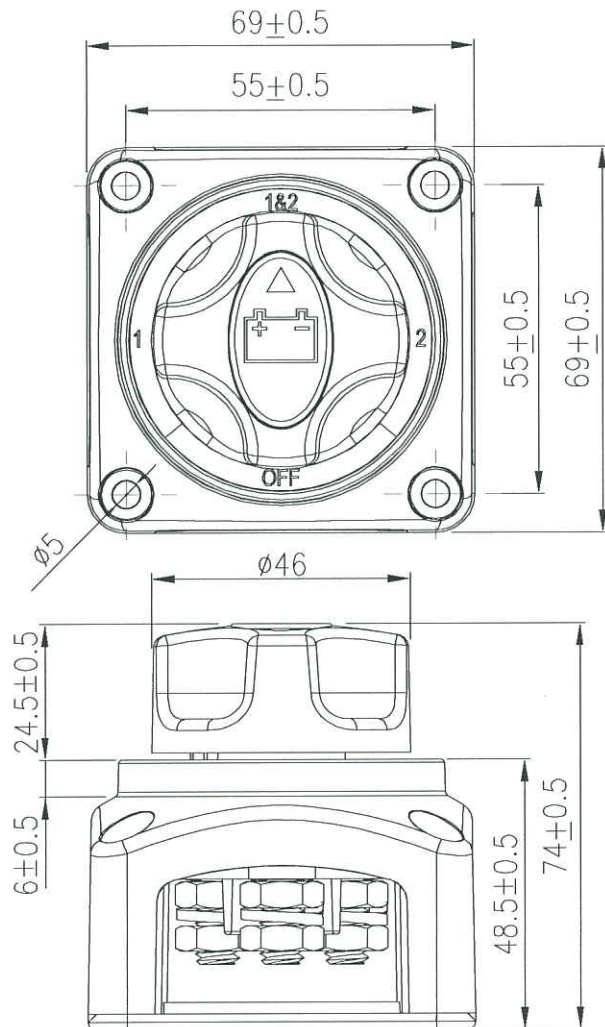

Continuous Rating	100 Amps 12~50 VDC	Mounting Hole		Circuit Diagram	
Intermittent Rating	300 Amps	A	B	OFF	B1 Com B2
Continuous Rating for UL-1107 requirement	100 Amps			1	B1 Com B2
Cranking Rating	1000 Amps			2	B1 Com B2
Insulation Resistance	DC 1000V 100M ohm Min.			1&2	B1 Com B2
Dielectric Strength	DC 2000V 1 minute AC 1000V 1 minute				
Operation Temperature	-20 °C~80°C				
Switch Function	OFF/1/2/1&2				
Actuation Force	5±0.5 Kgf-cm				

Material:

Actuator,Housing,Cover are PBT(UL flame:94V-0)

Contact Screw are copper alloy.

Nut are nickel plated brass.

Note:

1.Tolerance is $\pm 0.5\text{mm}(0.02")$ unless otherwise noted.